

SEWER PERMIT

LAKE COUNTY DEPARTMENT OF UTILITIES

Phone (440) 350-2652

Permit No. E-44905

Parcel No. 08A-04D-0-00-026

Lake County Administration Bldg.

105 Main Street

P.O. Box 490

Painesville, Ohio 44077-0490

S.D. Greater Mentor

New Conn. Repair Cut & Cap Reconn.

Date 06/02/2005

PERMISSION is hereby granted to JOHN BORKEY 7640 SARAH LEE DR, CONCORD, OH 44077

(Property Owner's Name & Address)

7640 SARAH LEE DRIVE

Sublot # 26

Bldg. #

Subdivision

(Property Address)

and to GREAT LAKES CRUSHING, LTD. 35650 LAKELAND BLVD. EASTLAKE, OH 44095
to the main sanitary sewer.

(Sewer Builder's Name & Address) to make connections

Drawing No.

Type Residential

Road Opening

17913

(type: single, com., ind., apt., etc.) SINGLE

Plumbing APPROVED

Raster

Tap-in Fees

Receipt No. 17238

AK Q-4-05 Billing

GreaterMentorPlan \$2,282.00

Inspection Fee \$100.00

Computer

234-S \$2,200.74

Other Fees: \$0.00

Taxmap

\$0.00

Mylar

\$0.00

Permit Amount: \$4,582.74

\$0.00

Note:

All work under this permit is to be done under the supervision of, and to the satisfaction of the County Sanitary Engineer and in conformity with the rules and regulations of this office. **SEWER WORK BY UNLICENSED BUILDERS WILL NOT BE ACCEPTED BY THE INSPECTOR.**

You are designated as LICENSED SEWER BUILDER on the permit and you may proceed with the work under the terms of your license. **WE ARE NOT RESPONSIBLE FOR THE ACCURACY OF THE LOCATION OF THE Y-BRANCH INFORMATION CONTAINED HEREIN.**

Construction Approved by


Roger Barbier

(Inspector)

Date: 6/10

2005

By TB

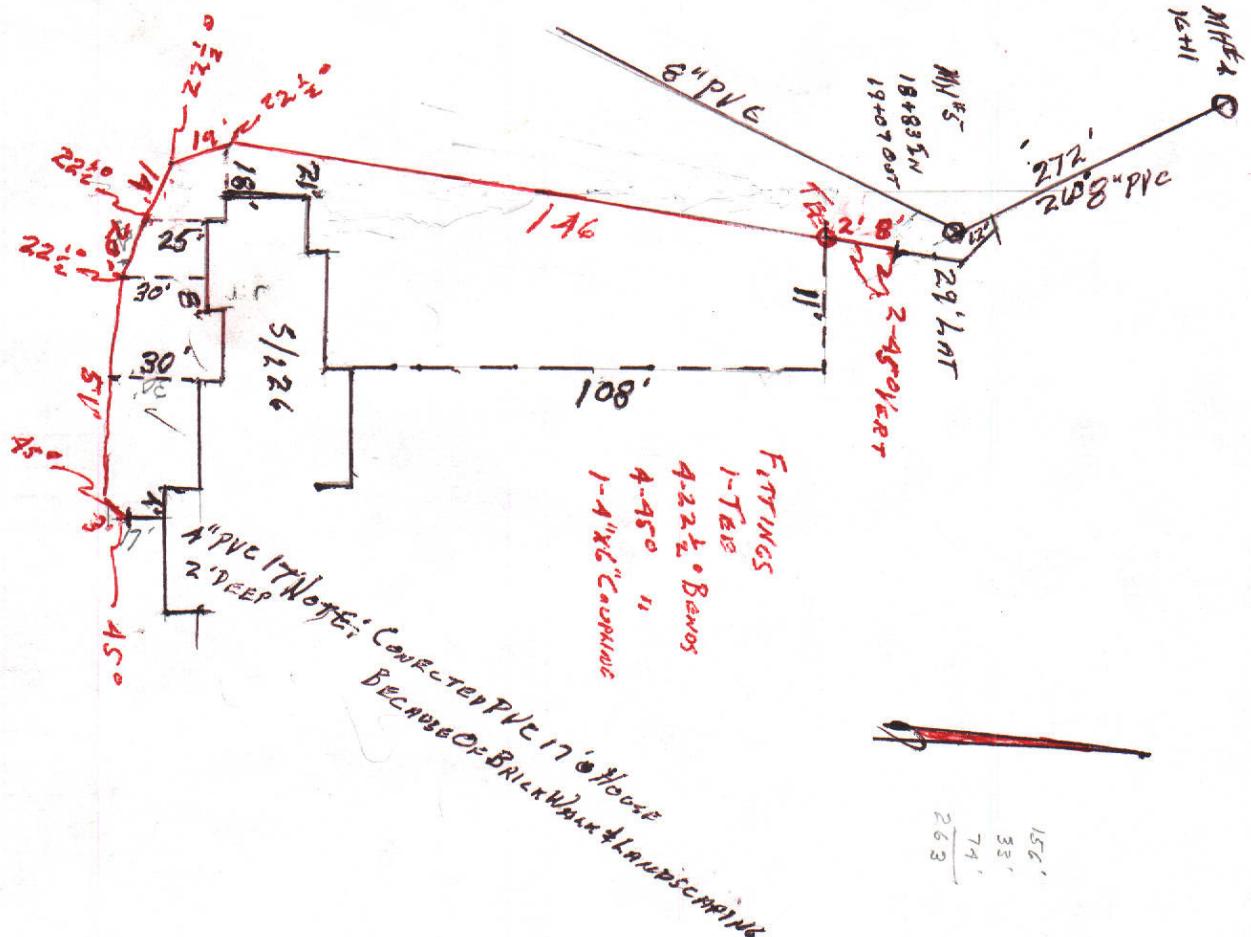

Inspector - Time of Arrival 6/10/05 6/11/05
Inspector - Time of Departure 8:00 8:00
Inspector - Hours on Job 6:00 4:00
Inspector - Hours on Job 9½ 8
Licensed Sewer Bldr - hrs on job 9½ 8
Sewer Builders Personnel:
NAME

JOHN SHINSKY
KRISTEN BOYD
CARL VOLAN

Permit No. E-44905
Lateral or Wye pipe
manufacturer found:
PVC

JOB TITLE

FORMAN
OPER
LABOR

Soil Conditions, type: CLAY & SANDSTONE
Soil Conditions, ground water (yes/no) No Trench width 2'
Ground water, if yes, vertical distance above or below maximum elevation of pipe
in feet — City water connected with meter YES
If well, Meter Installed — No. of Apts. — Units or Trailers 1
Pipe, Lin. ft. 263' Size 6" Type PVC Mfg. N. AMERICAN

EXFILTRATION TEST:

Head above top of pipe at maximum elevation in feet 2'
Allowable loss, in gallons 0.63 Actual loss, in gallons None
Length of test, in hours 1 Length of pipe tested 263'

DIMENSIONED PLAN

In detail with Wye or Lateral distance as found, detailed references to all bends and
fittings. Conn. to Building 1

INSPECTOR'S NAME Roger Barbier

Connection Date 6/10/05

BILLING DEPARTMENT
RESIDENTIAL/COMMERCIAL BILLING INFORMATION

OWNER JOHN BORKEY PERMIT NO. E-44905

INSPECTOR Roger Barban DATE OF CONNECTION 4/10/05

NO. OF UNITS 1 TYPE OF CONNECTION Res
(residential/apt/duplex/condo/comm/etc)

METER READING TYPE OF METER

OWNER BILLED YES

TENANT BILLED

NAME OF INDIVIDUAL TENANTS AND ADDRESSES
